



ALPHONSE & ELIZABETH
HARTUNG
ZONED: A-40


ALOIS J. LAMPERT
ZONED: A-40

MARTIN & DELORES
PIARSKI TRUST
ZONED: A-40

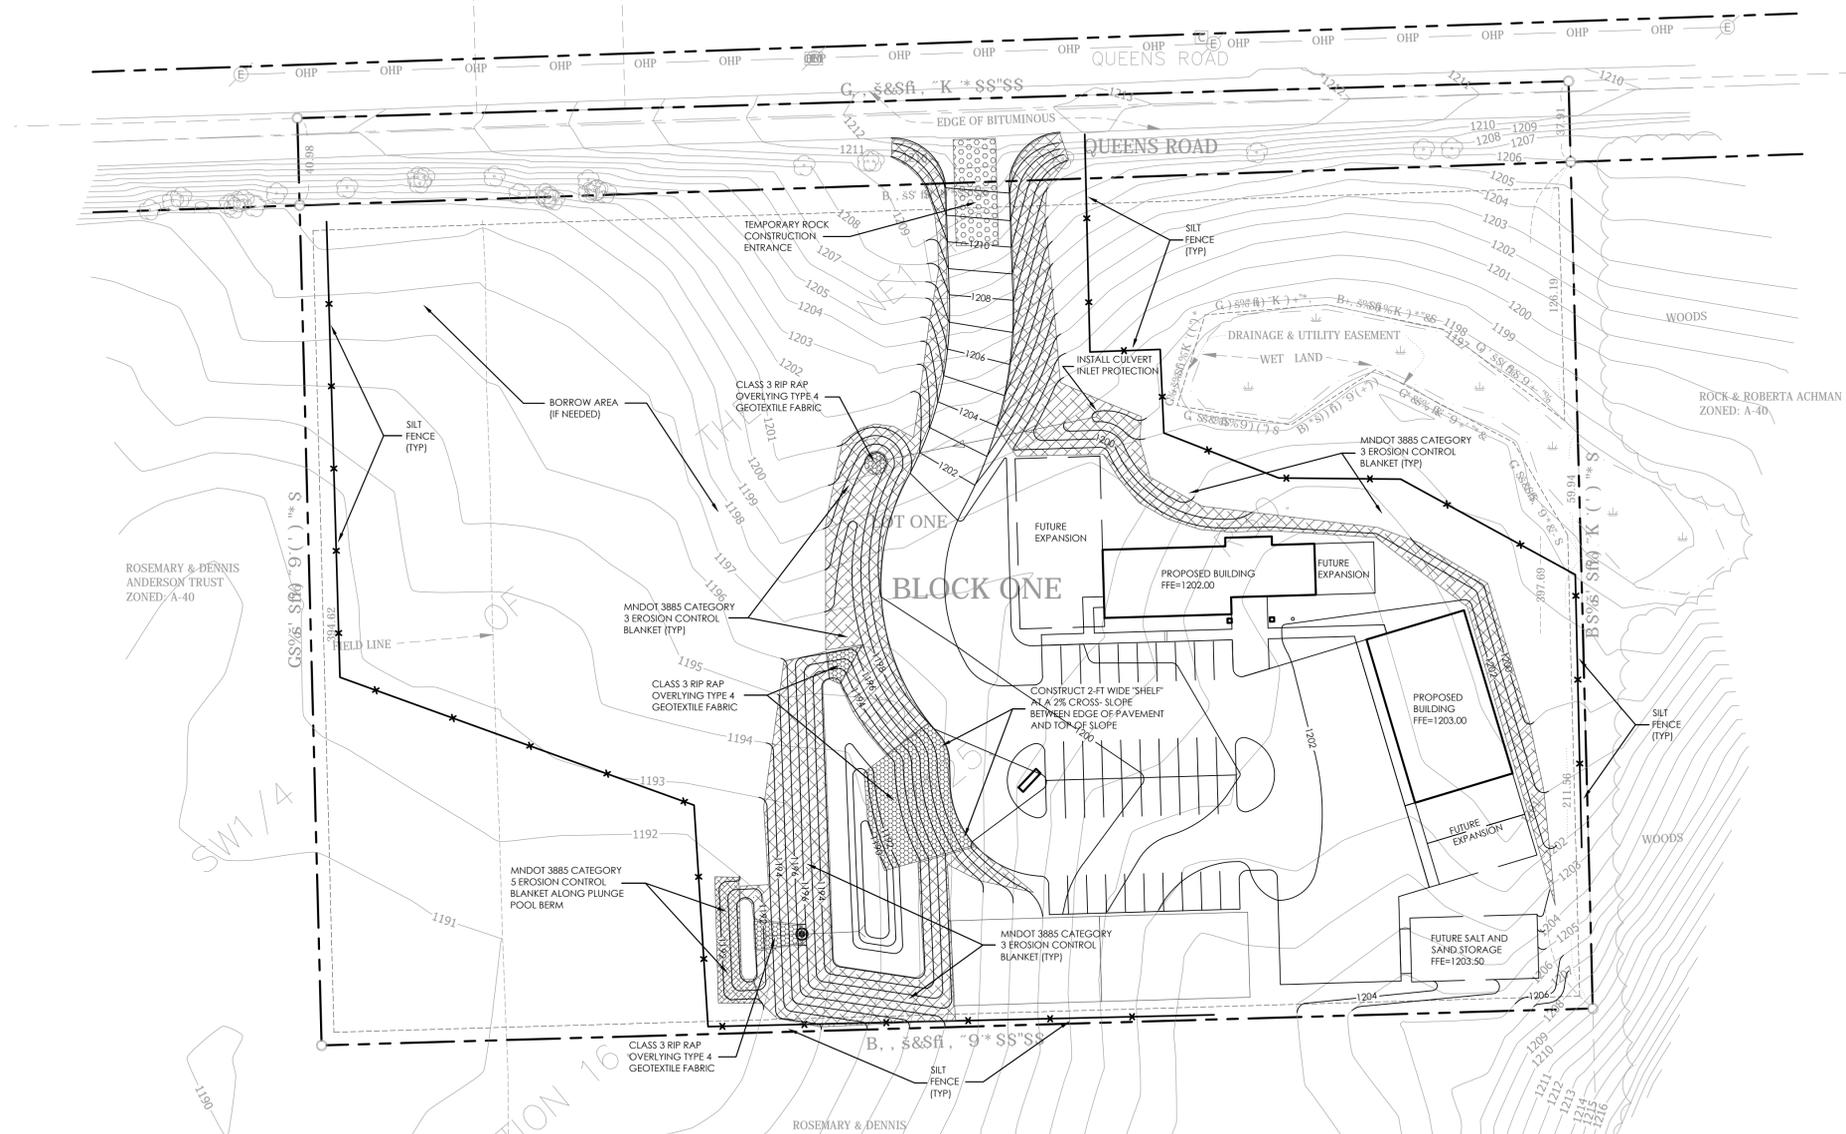


- A CHECK SLOT SHALL BE CONSTRUCTED AT THE TOP OF STEEP SLOPES (4:1 OR STEEPER) WHERE EROSION CONTROL BLANKET IS PLACED AS PER THE FOLLOWING:
1. DIG 6" X 6" TRENCH
 2. LAY BLANKET END INTO TRENCH
 3. STAPLE BLANKET IN BOTTOM OF TRENCH EVERY 1 FT
 4. BACKFILL TRENCH WITH SOIL AND COMPACT
 5. IF SLOPE LENGTH (L) IS GREATER THAN 100 FT DIG A CHECK SLOT 1/3 FROM THE BOTTOM OF THE SLOPE AND STAPLE THE BLANKET IN AS IN THE TOP TRENCH.

1 EROSION CONTROL BLANKET NTS




- NOTES:
1. RIP RAP SHALL MEET THE REQUIREMENTS OF MNDOT SPEC. 3601
 2. SEE PLANS FOR CLASS OF RIP RAP
 3. D=PIPE DIAMETER IN FEET (SEE PLANS)
 4. OUTLETS ON STEEP SLOPES SHALL BE PROVIDED WITH RIP RAP FROM THE OUTLET TO THE TOE OF THE SLOPE.

1 RIP RAP AT PIPE OUTLETS NTS

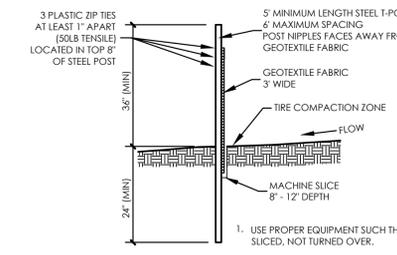

- MATERIALS PER MNDOT 3886
INSTALLATION PER MNDOT 2573.3C1
1. USE PROPER EQUIPMENT SUCH THAT THE SOIL IS SLICED, NOT TURNED OVER.
 2. AFTER SILT FENCE INSTALLATION, COMPACT THE SOIL IMMEDIATELY NEXT TO THE GEOTEXTILE BY DRIVING OVER IT WITH A TRACTOR TIRE AT LEAST TWICE


1 SILT FENCE (MACHINE SLICED) NTS

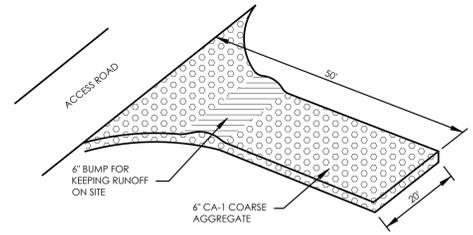

1. THE ROCK ENTRANCE SHALL BE CONSTRUCTED PRIOR TO THE START OF GRADING OPERATIONS.
2. THE ENTRANCE SHALL BE GRADED SUCH THAT POSITIVE DRAINAGE DURING CONSTRUCTION IS PROVIDED.
3. THE ENTRANCE SHALL BE MAINTAINED IN SUCH A CONDITION SUCH THAT IT PREVENTS MUD TRACKING OFF SITE. ADDITIONAL ROCK OR REPLACEMENT OF THE ENTRANCE MAY BE REQUIRED PERIODICALLY IF MUD STARTS TO TRACK OFF SITE.
4. THE ROCK ENTRANCE MAY BE REMOVED JUST PRIOR TO THE PLACEMENT OF AGGREGATE BASE.

NOTE: PLACING FILTER FABRIC UNDER THE ROCK ENTRANCE MAY REDUCE THE AMOUNT OF MAINTENANCE IT WOULD REQUIRE.

1 TEMPORARY ROCK CONSTRUCTION ENTRANCE NTS

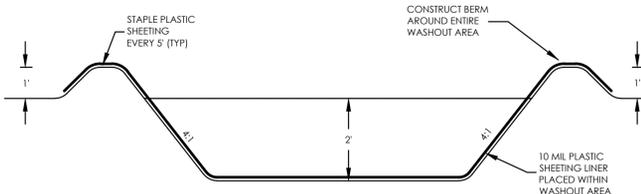

1. BOTTOM OF CONCRETE WASHOUT AREA SHALL BE 10'X10'
2. CONTRACTOR SHALL REMOVE WASH LIQUID FROM CONCRETE WASHOUT AREA AND DISPOSE OF PER MPCA REQUIREMENTS WHEN WASHOUT AREA BECOMES HALF FULL.
3. CONTRACTOR SHALL SELECT THE MOST OPTIMAL LOCATION FOR THE CONCRETE WASHOUT

5 CONCRETE WASHOUT NTS

STORM WATER POLLUTION PREVENTION PLAN-PLAN VIEW

1"=40'


I hereby certify that this plan, specification or report was prepared by me or under my direct supervision and that I am a duly licensed Engineer under the laws of the state of Minnesota.
Blaine J. Schultze, PE
Date: 02/03/2010 License No.: 48129

Schultz Engineering & Site Design, PLLC
P.O. Box 31
Surrey, MN 56377
Ph: (320) 253-9483
schultze@shive.com

808 Courthouse Square
St. Cloud, MN 56303
St. (320) 252-3740
fax (320) 255-0683
www.gltarchitects.com

GLTArchitects
Grooters • Leopoldt • Tideman

AVON TOWNSHIP FACILITIES QUEEN'S ROAD SITE
AVON TOWNSHIP, MINNESOTA PROJECT 10001



C4