

GENERAL PLAN NOTES


- DIMENSIONS ARE FROM FACE OF STUD TO FACE OF MASONRY UNLESS NOTED OTHERWISE. WRITTEN DIMENSIONS SHALL TAKE PRECEDENCE OVER SCALED DRAWINGS.
- SOME WALLS, WHETHER NOTED OR NOT, MAY NEED WIDER FRAMING TO ACCOMMODATE PLASTER, CONCRETE OR BLOCKWORK. VERIFY AND COORDINATE WITH MECHANICAL OR ELECTRICAL CONTRACTORS AND NOTIFY ARCHITECT OF ANY SUCH CHANGES.
- DIMENSIONS ON THE DRAWINGS ARE SUBJECT TO FIELD VERIFICATION TO SUIT ADJACENT WORK. VERIFY ALL DIMENSIONS AND REPORT ANY DISCREPANCIES TO THE ARCHITECT BY CONTRACTOR NOTIFY ARCHITECT OF ANY DISCREPANCIES.
- VERIFY LOCATIONS OF FLOOR DRAINS AND EQUIPMENT PANS WITH MECHANICAL AND ELECTRICAL CONTRACTORS.
- DOORS IN CORNERS SHOULD BE FRAMED TO BE A MINIMUM OF 3" AWAY FROM PERPENDICULAR WALL UNLESS NOTED OTHERWISE.
- ALL WALLS RUN TO DECK AND ARE SEALED TOP & BOTTOM EACH SIDE UNLESS NOTED OTHERWISE.
- WHEN WALLS ARE SPECIFIED WITH VENEER PLASTER ONE SIDE, ASSUME PLASTER WILL BE ON CORNER SIDE UNLESS NOTED OTHERWISE.
- SUBSTITUTE WATER RESISTANT GYPSUM BOARD IN ALL WET AREAS (MECHANICAL ROOMS, ELECTRICAL ROOMS, CUSTOMER ROOMS, ETC.).
- RUN ALL WALLS TO DECK LION. SEE DETAIL 33A/A2.
- CORNER GUARDS AT ALL HALLOWN CORNERS.

SPECIFIC PLAN NOTES

- WINDOWS ABOVE (SEE WINDOW SCHEDULE AND TYPICAL ELEVATIONS)
- MECHANICAL LOWERS VERIFY SIZE AND LOCATION WITH MECH
- MECHANICAL LOWERS ABOVE VERIFY SIZE AND LOCATION WITH MECH
- PRE-EXTENDING CABINET (SEE DETAIL 31A/1)
- PHOTOCOPY AREA OF SERVICE (MECHANICAL SPACE - 5'0" X 4'0" MIN. CLAD)
- REMOVE EXISTING DOOR AND FRAME
- REMOVE EXISTING WALL AND PATCH ADJACENT CONSTRUCTION AS REQ'D
- DAISYED LATE PHOTOS NEW 2"X6" FIBERGLASS
- PATCHED WALL PHOTOS CONTIGUOUS SMOKE BARRIER
- DOTTED LINE PHOTOS ONE-HOUR VERTICAL EXIT ENCLOSURE
- ALL CORRIDOR WALLS SHALL BE CONSTRUCTED AS SMOKE PARTITIONS
- ONE-HOUR FIRE RESISTIVE PARTS ENCLOSURE AT OUTSIDE STORAGE RIMS
- ONE-HOUR FIRE RESISTIVE PARTS ENCLOSURE AT SOLID UTILITY RIMS
- MECHANICAL SHUNT AT SECOND FLOOR ONLY - VERIFY SIZE WITH MECH
- MECHANICAL HANDRAIL ON BOTH SIDES OF CORRIDORS, TYP.

WALL TYPES - MAINTENANCE FACILITY

* ALL STUD FRAMING TO BE 1 1/2" O.C. UNLESS NOTED OTHERWISE
 - THICK WALL = D UNLESS OTHERWISE NOTED

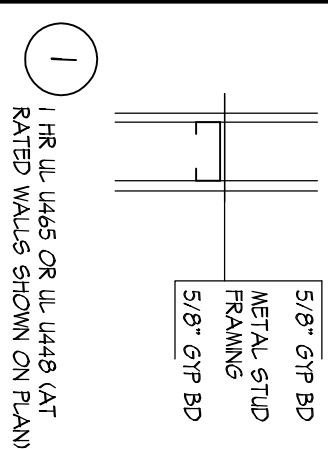

1. FR. TO BE USED OR TO BE USED AS KATED WALLS SHOWN ON PLAN

2.

3.

4.

WALL TYPE SCHEDULE KEY

MATERIAL	WOOD STUD	MASONRY	SUPPLEMENT
A	3/4"	--	1. FILL THICK SOUND INSULATION
B	1 1/2"	--	2. CERAMIC TILE & GEMENTICIOUS BOARD IN LEAF OF 5/8\"/>
C	2 1/2"	--	3. (2) LAYERS 5/8\"/>
D	3 1/2"	5 5/8"	3. VENEER PLASTER & 5/8\"/>
E	5 1/2"	5 5/8"	4. WOOD STUDS IN LEAF OF METAL STUDS
F	7 1/4"	7 5/8"	5. GYP RD DIRECT GLUED TO SUBSTRATE IN LEAF OF FIBROG
G	11 1/4"	11 5/8"	6. GYP RD ON ONE SIDE ONLY
H	--	14 5/8"	7. RESIDENT CHANNELS IN LEAF OF SECOND LAYER OF GYPSUM BOARD
			8. VENEER PLASTER & 5/8\"/>
			9. STD FRAMING AT 24\"/>

